LAS1 CEILING MOUNT KIT T-GRID 15/16”

LAS-RM-TBAR | INSTALLATION INSTRUCTIONS

IMPORTANT SAFETY WARNINGS

THE INSTALLATION MUST ONLY BE PERFORMED BY A LICENSED ELECTRICIAN. TO PREVENT DEATH, INJURY OR DAMAGE TO PROPERTY, THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE TO NATIONAL ELECTRICAL CODE (NEC), NFPA 70 IN THE U.S. OR CANADIAN ELECTRICAL CODE, CSA C22.1 IN CANADA.

L’INSTALLATION DOIT IMPÉRATIVEMENT ÊTRE EFFECTUÉE PAR UN ÉLECTRICIEN QUALIFIÉ. AFIN DE PRÉVENIR TOUT RISQUE DE DÉCÈS, DE BLESSURE OU DE DOMMAGES MATÉRIELS, CE PRODUIT DOIT ÊTRE INSTALLÉ CONFORMÉMENT AU CODE NATIONAL DE L’ÉLECTRICITÉ (NEC), NORME NFPA 70 AUX ÉTATS-UNIS, OU AU CODE CANADIEN DE L’ÉLECTRICITÉ, NORME CSA C22.1 AU CANADA.


CONSULT A QUALIFIED ELECTRICIAN TO ENSURE CORRECT BRANCH CIRCUIT CONDUCTOR.

CONSULTER UN ÉLECTRICIEN QUALIFIÉ POUR VOUS ASSURER QUE LES CONDUCTEURS DE LA DÉRIVATION SONT ADÉQUATS.

CAUTION – RISK OF FIRE. MIN 75°C (167°F) SUPPLY CONDUCTORS.

ATTENTION – RISQUE D’INCENDIE. LES FILS D’ALIMENTATION 75°C (167°F) MIN.

- To reduce the risk of death, personal injury or property damage from fire, electric shock, falling parts, cuts/abrasions, and other hazards please read all warnings and instructions included with the fixture box and labels.
- Follow all manufacturer’s warnings and restrictions for: driver type, burning position, mounting locations/methods, replacement and recycling.
- Wear gloves and safety glasses at all times when removing luminaire from carton, installing, servicing or performing maintenance.
- Disconnect or turn off power before installation or servicing the luminaire.
- Allow fixture to cool before handling.
- Do not exceed maximum wattage marked on the label.
- Do not operate in close proximity to persons, combustible materials or substances affected by heat or drying.
- Verify that supply voltage is correct by comparing it with label information.
- Wiring connections should be capped with UL-approved wire connectors.
- DO NOT INSTALL DAMAGED PRODUCT! This luminaire has been properly packed so that no parts should have been damaged during transit. Inspect to confirm. Any part damaged during or after assembly should be replaced.
- Maintenance should be performed by person(s) familiar with the luminaires’ construction and operation and any hazards involved. Regular fixture maintenance programs are recommended.
- It will occasionally be necessary to clean the outside of the refractor/lens. Frequency of cleaning will depend on ambient dirt level and minimum light output which is acceptable to user. Refractor/lens should be washed in a solution of warm water and any mild, non-abrasive household detergent, rinsed with clean water and wiped dry.
- Should optical assembly become dirty on the inside, wipe lens and clean in above manner, replacing damaged gaskets as necessary.
- These instructions do not purport to cover all details or variations in equipment nor to provide every possible contingency to meet in connection with installation, operation, or maintenance.

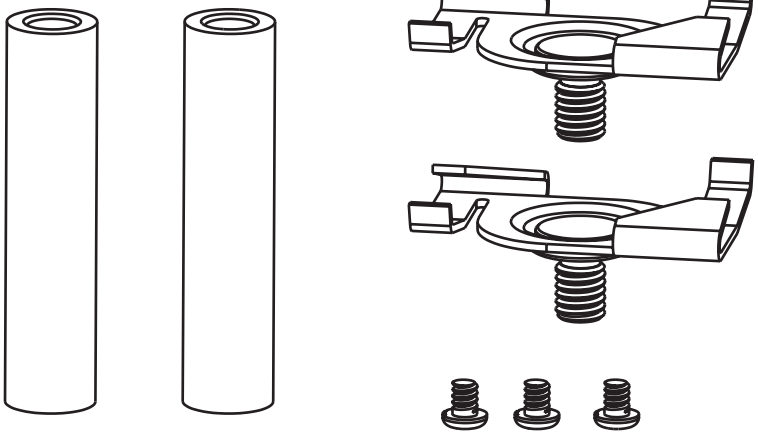


Specifications and dimensions subject to change without notice.


LAS1 CEILING MOUNT KIT T-GRID 15/16”

LAS-RM-TBAR | INSTALLATION INSTRUCTIONS


CEILING MOUNT INSTALLATION

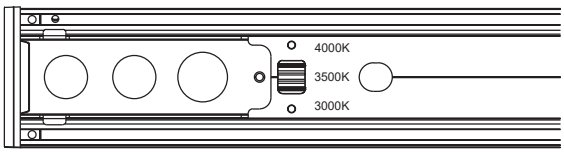


1. Set the LAS1 to the desired CCT and power in advance of the installation.

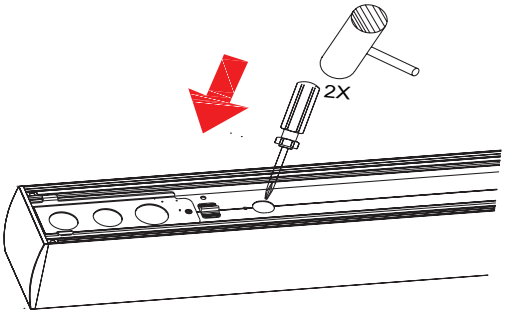


2. Use a tool to open the pre-existing access holes on the LAS1.

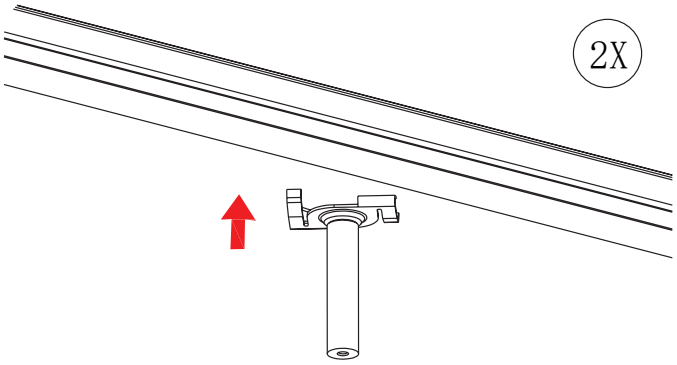


3A. Install the T-grid clip assembly onto the T-grid runner.

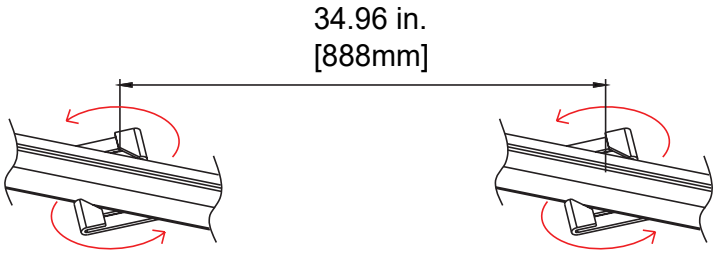


3B. Spacing between the two mounting clips is as shown in the figure above.

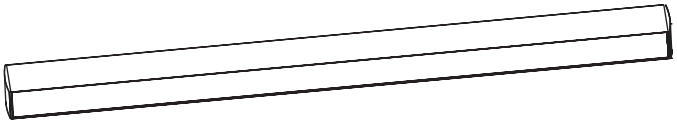

4. Remove the diffuser cover from the LAS1.

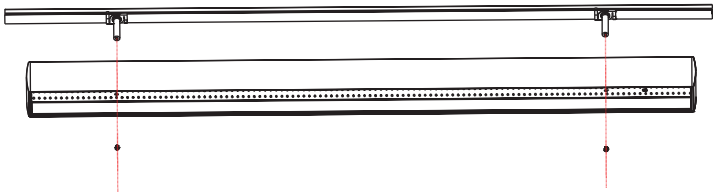

5. Align the LAS1 with the mounting hardware on the T-grid runner, pass it through, and secure it with supplied mounting screws.



6. After securing the LAS1, reinstall the diffuser.